

Источники питания N-132/2-01, N-132/2-10

Технические характеристики

По вопросам продаж и поддержки обращайтесь:

Алматы (727)345-47-04
Ангарск (3955)60-70-56
Архангельск (8182)63-90-72
Астрахань (8512)99-46-04
Барнаул (3852)73-04-60
Белгород (4722)40-23-64
Благовещенск (4162)22-76-07
Брянск (4832)59-03-52
Владивосток (423)249-28-31
Владикавказ (8672)28-90-48
Владимир (4922)49-43-18
Волгоград (844)278-03-48
Вологда (8172)26-41-59
Воронеж (473)204-51-73
Екатеринбург (343)384-55-89

Иваново (4932)77-34-06
Ижевск (3412)26-03-58
Иркутск (395)279-98-46
Казань (843)206-01-48
Калининград (4012)72-03-81
Калуга (4842)92-23-67
Кемерово (3842)65-04-62
Киров (8332)68-02-04
Коломна (4966)23-41-49
Кострома (4942)77-07-48
Краснодар (861)203-40-90
Красноярск (391)204-63-61
Курск (4712)77-13-04
Курган (3522)50-90-47
Липецк (4742)52-20-81

Магнитогорск (3519)55-03-13
Москва (495)268-04-70
Мурманск (8152)59-64-93
Набережные Челны (8552)20-53-41
Нижний Новгород (831)429-08-12
Новокузнецк (3843)20-46-81
Ноябрьск (3496)41-32-12
Новосибирск (383)227-86-73
Омск (3812)21-46-40
Орел (4862)44-53-42
Оренбург (3532)37-68-04
Пенза (8412)22-31-16
Петрозаводск (8142)55-98-37
Псков (8112)59-10-37
Пермь (342)205-81-47

Ростов-на-Дону (863)308-18-15
Рязань (4912)46-61-64
Самара (846)206-03-16
Санкт-Петербург (812)309-46-40
Саратов (845)249-38-78
Севастополь (8692)22-31-93
Саранск (8342)22-96-24
Симферополь (3652)67-13-56
Смоленск (4812)29-41-54
Сочи (862)225-72-31
Ставрополь (8652)20-65-13
Сургут (3462)77-98-35
Сыктывкар (8212)25-95-17
Тамбов (4752)50-40-97
Тверь (4822)63-31-35

Тольятти (8482)63-91-07
Томск (3822)98-41-53
Тула (4872)33-79-87
Тюмень (3452)66-21-18
Ульяновск (8422)24-23-59
Улан-Удэ (3012)59-97-51
Уфа (347)229-48-12
Хабаровск (4212)92-98-04
Чебоксары (8352)28-53-07
Челябинск (351)202-03-61
Череповец (8202)49-02-64
Чита (3022)38-34-83
Якутск (4112)23-90-97
Ярославль (4852)69-52-93

Россия +7(495)268-04-70

Казахстан +(727)345-47-04

Беларусь +(375)257-127-884

Узбекистан +998(71)205-18-59

Киргизия +996(312)96-26-47

эл.почта: ret@nt-rt.ru || сайт: <https://rechner.nt-rt.ru>




Isolating Switching Amplifier
Series N-132 - ATEX
Article number N00015
Description N-132/2-01 120...230 V AC

- To connect two NAMUR-Sensors or potential-free mechanical contacts, which are mounted in the zones 0, 1, 2 (Gas) or 20, 21, 22 (dust)
- Compact design - only 17.6 mm width
- Removable screw terminals
- Indication sensor wire-break or short circuit via LED display
- For applications up to SIL 2 according to IEC 61508



Technical data

Operating voltage (U_B)	120...230 V AC
Output function	2 x change-over contact potential-free
Contact rating each relay AC max.	250 V AC / 4 A
Contact rating each relay DC max.	250 V DC / 2 A
No-load voltage max. (U_o)	9.6 V DC
No-load current (I_o)	Typ. 18 mA
Short-circuit current max. (I_K)	20 mA
Outer inductance max. (L_o)	[Ex ia] IIC 90 mH / IIB 340 mH
Outer capacitance max. (C_o)	[Ex ia] IIC 3.6 μ F / IIB 26 μ F
Actuating signal	NAMUR EN 60547-5-6
Permitted ambient temperature	-20...+70 °C
Display	Red / yellow and green
Degree of protection IEC 60529	Housing: IP 30 / Terminals: IP 20
Norm	EN 60947-5-6
Connection	Screw terminals
ATEX certificate	DMT 09 ATEX E 087X
ATEX product marking gas	Ex II (1) G [Ex ia Ga] IIC
ATEX product marking dust	Ex II (1) D [Ex ia Da] IIIC
IECEx certificate	IECEx BVS 10.0088X
IECEx product marking gas	[Ex ia Da] IIC
IECEx product marking dust	[Ex ia Ga] IIIC
Certificate(s)	FM
Safety integrity level (IEC 61508)	SIL 2
MTTF (average operating time until failure in Years)	62 years
Accessories (not included in delivery)	# 190760 pac-Bus single element, # 190761 Terminal set for pac-Bus

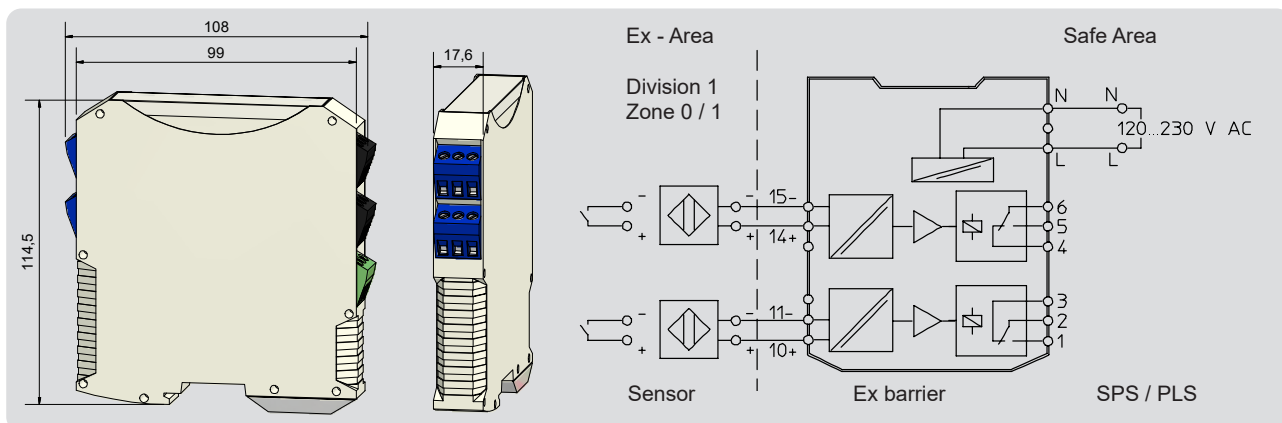



Isolating Switching Amplifier
Series N-132 - ATEX
Article number N00017
Description N-132/2-10 24 V DC


- To connect two NAMUR-Sensors or potential-free mechanical contacts, which are mounted in the zones 0, 1, 2 (Gas) or 20, 21, 22 (dust)
- Compact design - only 17.6 mm width
- Removable screw terminals
- Indication sensor wire-break or short circuit via LED display
- For applications up to SIL 2 according to IEC 61508



Technical data

Operating voltage (U_B)	18...31.2 V DC
Output function	2 x change-over contact potential-free
Contact rating each relay AC max.	250 V AC / 4 A
Contact rating each relay DC max.	250 V DC / 2 A
No-load voltage max. (U_o)	9.6 V DC
No-load current (I_o)	Typ. 55 mA
Short-circuit current max. (I_K)	20 mA
Outer inductance max. (L_o)	[Ex ia] IIC 90 mH / IIB 340 mH
Outer capacitance max. (C_o)	[Ex ia] IIC 3.6 μ F / IIB 26 μ F
Actuating signal	NAMUR EN 60547-5-6
Permitted ambient temperature	-20...+70 °C
Display	Red / yellow and green
Degree of protection IC 60529	Housing: IP 30 / Terminals: IP 20
Norm	EN 60947-5-6
Connection	Screw terminals
Certificate(s)	FM
Safety integrity level (IEC 61508)	SIL 2
MTTF (average operating time until failure in Years)	62 years
Accessories (not included in delivery)	# 190760 pac-Bus single element, # 190761 Terminal set for pac-Bus

ATEX certificate	DMT 09 ATEX E 087X	CCC certificate	2020312316000055
ATEX product marking gas	Ex II (1) G [Ex ia Ga] IIC	CCC product marking gas	[Ex ia Ga] IIC
ATEX product marking dust	Ex II (1) D [Ex ia Da] IIIC	CCC product marking dust	[Ex iaD]
IECEx certificate	IECEx BVS 10.0088X	KTL certificate	13-KB4BO-0160
IECEx product marking gas	[Ex ia Ga] IIC	KTL product marking gas	(Ex [ia] IIC)
IECEx product marking dust	[Ex ia Da] IIIC		

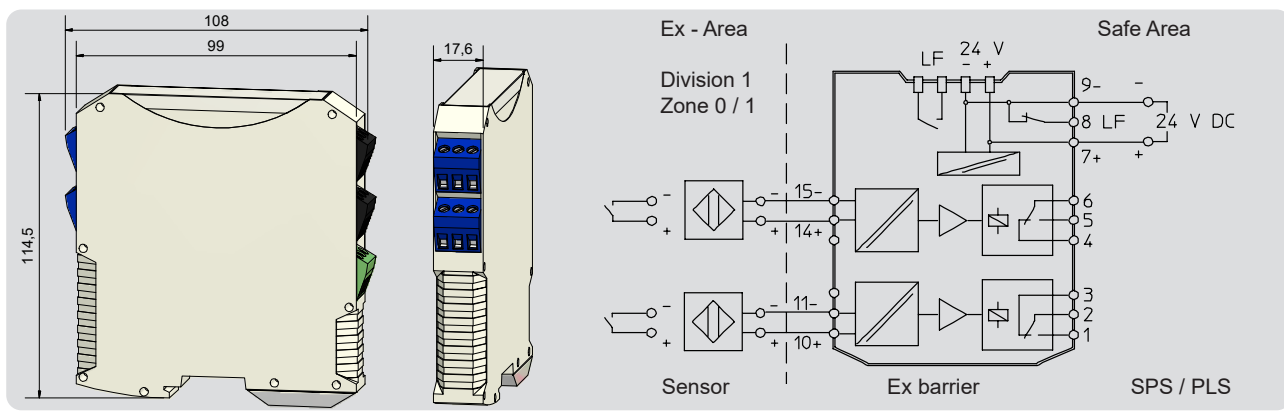



По вопросам продаж и поддержки обращайтесь:

Алматы (727)345-47-04
Ангарск (3955)60-70-56
Архангельск (8182)63-90-72
Астрахань (8512)99-46-04
Барнаул (3852)73-04-60
Белгород (4722)40-23-64
Благовещенск (4162)22-76-07
Брянск (4832)59-03-52
Владивосток (423)249-28-31
Владикавказ (8672)28-90-48
Владимир (4922)49-43-18
Волгоград (844)278-03-48
Вологда (8172)26-41-59
Воронеж (473)204-51-73
Екатеринбург (343)384-55-89

Иваново (4932)77-34-06
Ижевск (3412)26-03-58
Иркутск (395)279-98-46
Казань (843)206-01-48
Калининград (4012)72-03-81
Калуга (4842)92-23-67
Кемерово (3842)65-04-62
Киров (8332)68-02-04
Коломна (4966)23-41-49
Кострома (4942)77-07-48
Краснодар (861)203-40-90
Красноярск (391)204-63-61
Курск (4712)77-13-04
Курган (3522)50-90-47
Липецк (4742)52-20-81

Магнитогорск (3519)55-03-13
Москва (495)268-04-70
Мурманск (8152)59-64-93
Набережные Челны (8552)20-53-41
Новокузнецк (3843)20-46-81
Ноябрьск (3496)41-32-12
Новосибирск (383)227-86-73
Омск (3812)21-46-40
Орел (4862)44-53-42
Оренбург (3532)37-68-04
Пенза (8412)22-31-16
Петрозаводск (8142)55-98-37
Псков (8112)59-10-37
Пермь (342)205-81-47

Ростов-на-Дону (863)308-18-15
Рязань (4912)46-61-64
Самара (846)206-03-16
Санкт-Петербург (812)309-46-40
Саратов (845)249-38-78
Севастополь (8692)22-31-93
Саранск (8342)22-96-24
Симферополь (3652)67-13-56
Смоленск (4812)29-41-54
Сочи (862)225-72-31
Ставрополь (8652)20-65-13
Сургут (3462)77-98-35
Сыктывкар (8212)25-95-17
Тамбов (4752)50-40-97
Тверь (4822)63-31-35

Тольятти (8482)63-91-07
Томск (3822)98-41-53
Тула (4872)33-79-87
Тюмень (3452)66-21-18
Ульяновск (8422)24-23-59
Улан-Удэ (3012)59-97-51
Уфа (347)229-48-12
Хабаровск (4212)92-98-04
Чебоксары (8352)28-53-07
Челябинск (351)202-03-61
Череповец (8202)49-02-64
Чита (3022)38-34-83
Якутск (4112)23-90-97
Ярославль (4852)69-52-93

Россия +7(495)268-04-70

Казахстан +(727)345-47-04

Беларусь +(375)257-127-884

Узбекистан +998(71)205-18-59

Киргизия +996(312)96-26-47